




SECTION No. 9

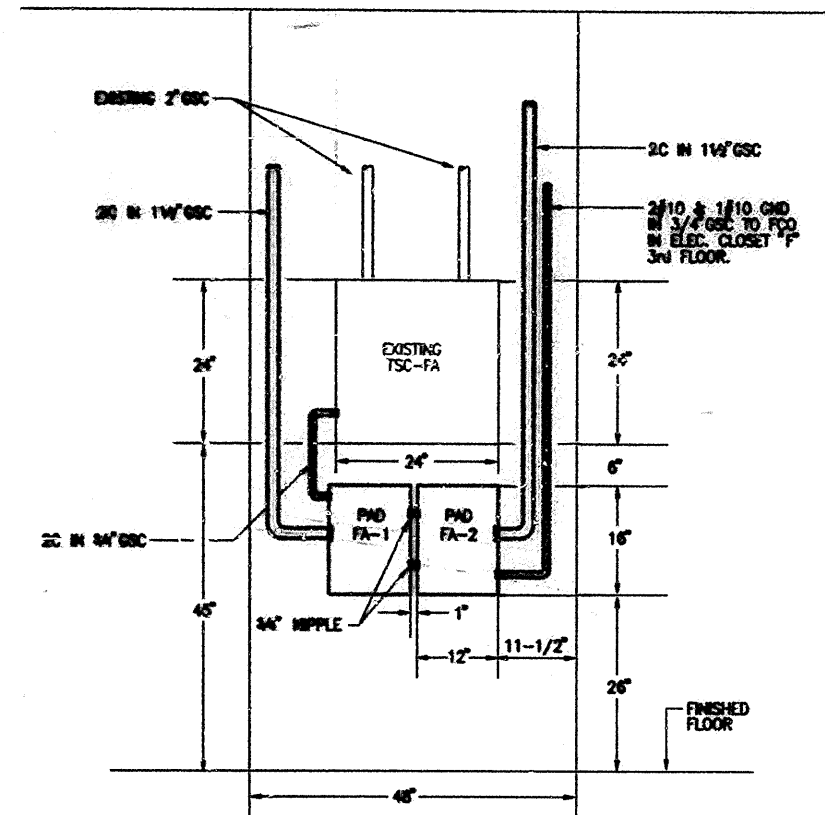

**SECTION C-C (DWG E-02-105)**  
5 WTC 2nd FLOOR TSC-FA  
LOCATED IN E.A. CLOSET FC-ME-4  
SEE NOTE 2 (TYP)  
N.T.S.

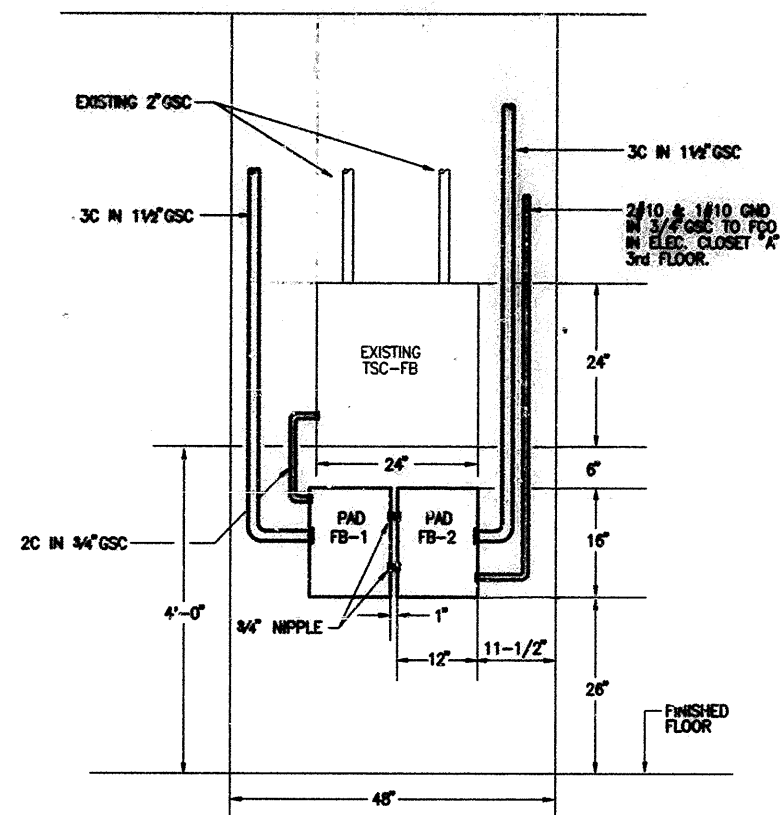


**SECTION A-A (DWG E-02-106)**  
5 WTC 2nd FLOOR TSC-FB  
LOCATED IN E.A. CLOSET FC-ME-5  
SEE NOTE 2 (TYP)  
N.T.S.

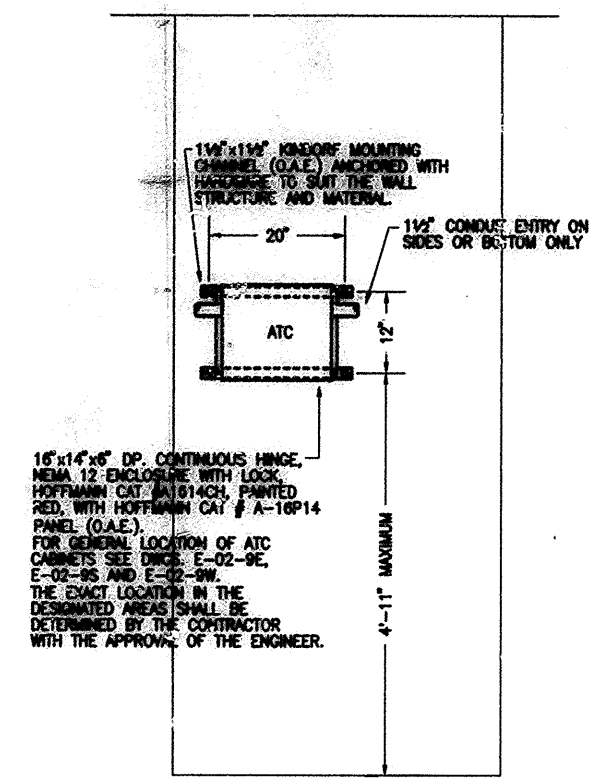


**ELEVATION VIEW**  
TYPICAL MOUNTING OF ATC CABINETS  
ATC-2A-1, ATC-2B-1 & ATC-2E-1  
SEE NOTE 2 (TYP)  
N.T.S.

1. FOR LEGEND, ABBREVIATIONS, AND GENERAL NOTES, SEE DWG. E-02-1.
2. FOR WIRING DIAGRAMS SEE DWGS. E-02-5, E-02-6, E-02-11 THRU E-02-19 AND DWGS. MXLRV-NE-M2-1 & MXLRV-NE-M2-2.
3. RETURN ALL REMOVED EXISTING DEVICES TO THE ENGINEER.
4. THE AUTHORITY WILL FURNISH THE AMPLIFIER CABINET FOR INSTALLATION BY THE CONTRACTOR.
5. ALL WORK PERFORMED ON FIRE ALARM EQUIPMENT, WIRING, CONDUIT AND ACCESSORIES SHOWN ON THIS DRAWING SHALL BE DONE IN THE PRESENCE OF THE ENGINEER AND IN STRICT ACCORDANCE WITH THE CONTRACT DRAWINGS AND THE CONTRACT SPECIFICATIONS.  
IN THE EVENT OF A CONFLICT, THE CONTRACTOR SHALL SUBMIT THE DISPUTED ITEM(S) TO THE ENGINEER FOR RESOLUTION BEFORE PROCEEDING WITH THE WORK IN QUESTION.

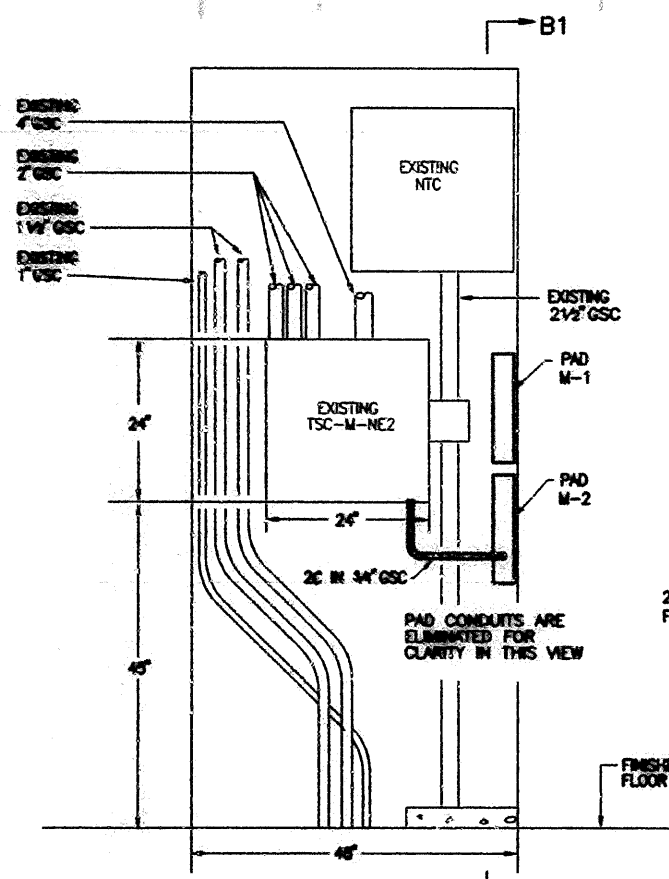


**SECTION B-B (DWG E-02-107)**

5 WTC 2nd FLOOR TSC-M-NE2  
LOCATED IN E.A. CLOSET FC-ME-2  
SEE NOTE 2 (TYP)  
N.T.S.

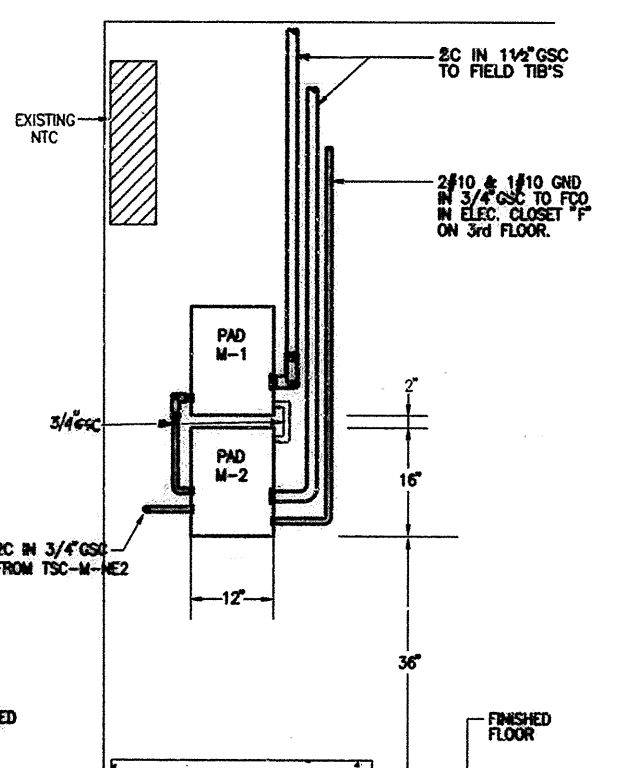


**SECTION B1-B1**

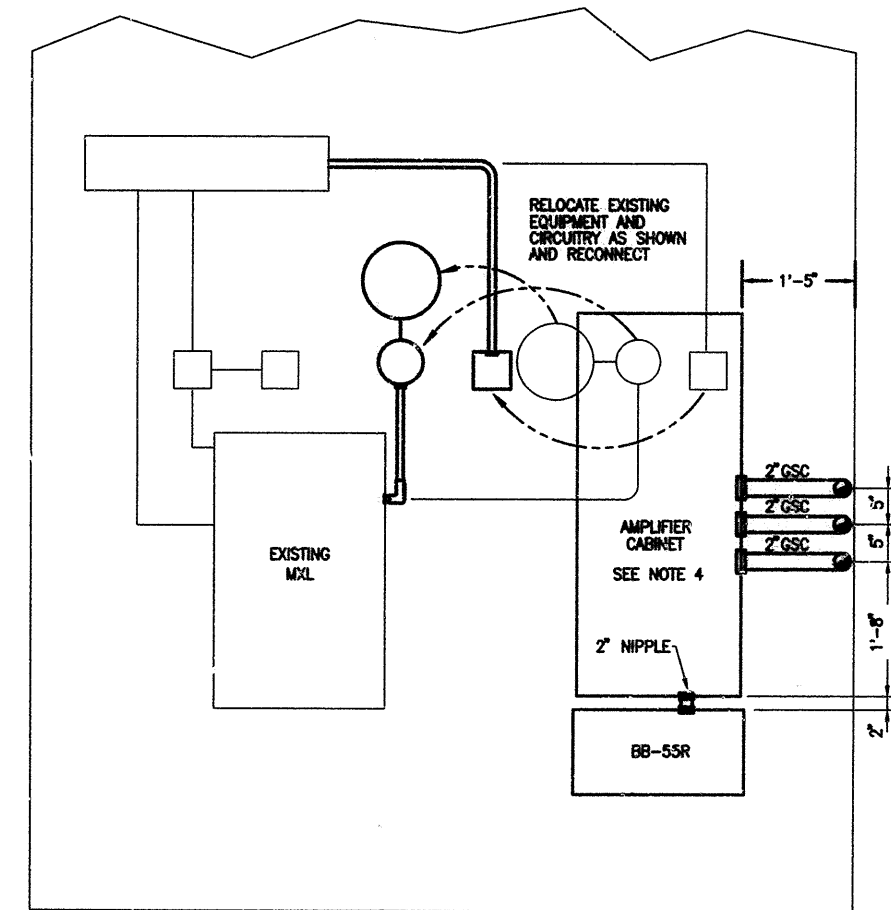

**SECTION D-D (DWG E-02-108)**

5 WTC 2nd FLOOR E.A. E.C.  
LOCATED IN BORDER'S MECH. ROOM  
SEE NOTE 2 (TYP)  
N.T.S.

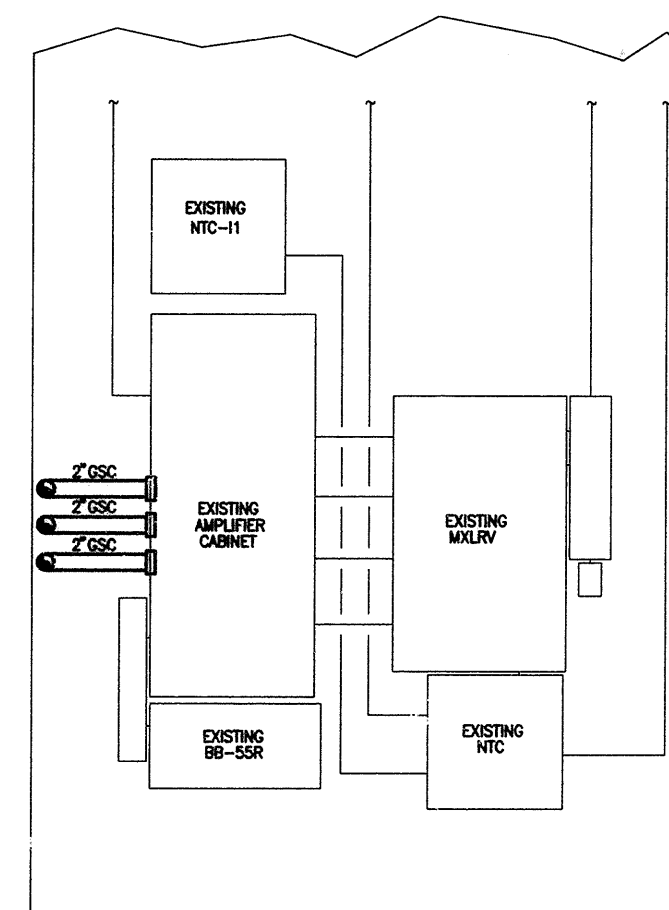

**SECTION E-E (DWG E-02-109)**

Sheet 9 of 10

ENGINEERING DEPARTMENT

WORLD TRADE CENTER

**ELECTRICAL**

Title: FIRE ALARM SYSTEM DEVICE UPGRADE PHASE III

5 WTC PLAZA LEVEL FIRE ALARM EQUIPMENT MODIFICATION AND INSTALLATION DETAILS

This drawing subject to conditions in Contract. All inventions, ideas, designs and methods herein are reserved to Port Authority and may not be used without its written consent.

FELDSSTEIN B. FAROUKI A.S.  
Designed by Drawn by Checked by

MAY 31, 1999  
Date

WTC-061.572 E-02-7  
Contract Number Drawing Number